

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-01	Sample Name: North Cola Fountain Sampled: 6/29/16 6:43		Matrix: Water				
+Lead	1030	EPA 200.9	3.3	ppb	2.0	20 ppb	07/27/16 17:05
6183006-02	Sample Name: WESD Port Fountain Sampled: 6/29/16 6:50		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-03	Sample Name: CV Boys LK Sampled: 6/29/16 7:35		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-04	Sample Name: CV girls LK Sampled: 6/29/16 7:38		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-05	Sample Name: CV Gym Tall Sampled: 6/29/16 7:31		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-06	Sample Name: CV Gym Short Sampled: 6/29/16 7:33		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-07	Sample Name: AC fountain 2nd fl. by boys Room Tall Sampled: 6/28/16 11:23		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-08	Sample Name: AC fountain 2nd fl. by boys Room Short Sampled: 6/28/16 11:25		Matrix: Water				
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-09	Sample Name: AC - C202 Sampled: 6/28/16 11:28		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-10	Sample Name: AC - Commons by A102 Sampled: 6/28/16 11:31		Matrix: Water				
+Lead	1030	EPA 200.9	4.5	ppb	2.0	20 ppb	07/27/16 17:05

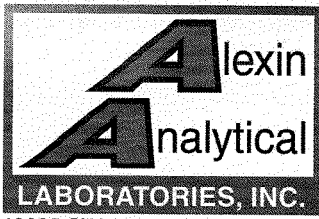

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-11	Sample Name: AC - Staff Lunch Rm Sampled: 6/28/16 11:34		Matrix: Water				
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-12	Sample Name: Sitka main kit. sink Sampled: 6/28/16 12:51		Matrix: Water				
+Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	07/27/16 17:05
6183006-13	Sample Name: Sitka Game Rm Sampled: 6/28/16 12:55		Matrix: Water				
+Lead	1030	EPA 200.9	29.4	ppb	2.0	20 ppb	07/27/16 17:05 MCLE
6183006-14	Sample Name: Sitka Back Port - fountain Right Sampled: 6/28/16 12:58		Matrix: Water				
+Lead	1030	EPA 200.9	67.1	ppb	4.0	20 ppb	07/27/16 17:05 MCLE
6183006-15	Sample Name: Sitka Back Port - fountain Left Sampled: 6/28/16 13:03		Matrix: Water				
+Lead	1030	EPA 200.9	2.4	ppb	2.0	20 ppb	07/27/16 17:05
6183006-16	Sample Name: South Cola Port sink Sampled: 6/29/16 6:35		Matrix: Water				
+Lead	1030	EPA 200.9	15.4	ppb	2.0	20 ppb	07/27/16 17:05
6183006-17	Sample Name: CV kit. Prep sink Sampled: 6/28/16 10:12		Matrix: Water				
+Lead	1030	EPA 200.9	9.7	ppb	2.0	20 ppb	07/27/16 17:05
6183006-18	Sample Name: CV Fountains near Gym - Tall Sampled: 6/28/16 10:15		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-19	Sample Name: CV Fountain near Gym - Short Sampled: 6/28/16 10:16		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-20	Sample Name: CV Staff Rm Sampled: 6/28/16 10:20		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

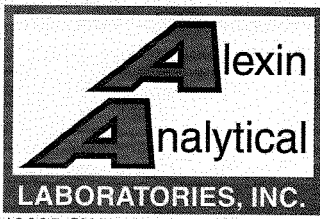

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-21	Sample Name: Hall fountain by 117 Tall Sampled: 6/28/16 10:22						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-22	Sample Name: Hall fountain by 117 Short Sampled: 6/28/16 10:24						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-23	Sample Name: CV #112 Sampled: 6/28/16 10:28						Matrix: Water
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
6183006-24	Sample Name: CV #113 Sampled: 6/28/16 10:31						Matrix: Water
+Lead	1030	EPA 200.9	4.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-25	Sample Name: Hall fountain 211 - Tall Sampled: 6/28/16 10:36						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-26	Sample Name: Hall fountain 211 Short Sampled: 6/28/16 10:39						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-27	Sample Name: Edwards Fountain by #30 Sampled: 6/28/16 7:16						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-28	Sample Name: Edwards #27 Sampled: 6/28/16 7:18						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-29	Sample Name: Edwards #23 Sampled: 6/28/16 7:21						Matrix: Water
+Lead	1030	EPA 200.9	6.6	ppb	2.0	20 ppb	07/27/16 17:05
6183006-30	Sample Name: Dundee Food Prep sink #1 Kit. Sampled: 6/28/16 8:03						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

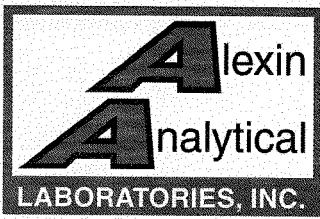

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-31	Sample Name: Dundee Food Prep sink #2 Kit. Sampled: 6/28/16 8:04						Matrix: Water
+Lead	1030	EPA 200.9	2.7	ppb	2.0	20 ppb	07/27/16 17:05
6183006-32	Sample Name: Dundee cafe fountain - Tall Sampled: 6/28/16 8:13						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-33	Sample Name: Dundee cafe fountain - Short Sampled: 6/28/16 8:14						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-34	Sample Name: Dundee #35 Sampled: 6/28/16 8:19						Matrix: Water
+Lead	1030	EPA 200.9	13.3	ppb	2.0	20 ppb	07/27/16 17:05
6183006-35	Sample Name: Dundee #31 Sampled: 6/28/16 8:22						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-36	Sample Name: Dundee #32 Sampled: 6/28/16 8:26						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-37	Sample Name: Edwards Gym fountain Sampled: 6/28/16 6:48						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-38	Sample Name: Edwards #15 Sampled: 6/28/16 6:51						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-39	Sample Name: Edwards Hall fountain by #15 Sampled: 6/28/16 6:54						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-40	Sample Name: Edwards #13 Sampled: 6/28/16 6:57						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

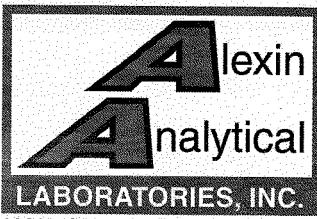

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-41	Sample Name: Edwards Staff Lunch Rm Sampled: 6/28/16 7:00		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-42	Sample Name: Edwards #39 Sampled: 6/28/16 7:02		Matrix: Water				
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-43	Sample Name: Edwards fountain by #39 Sampled: 6/28/16 7:05		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-44	Sample Name: Edwards #38 Sampled: 6/28/16 7:08		Matrix: Water				
+Lead	1030	EPA 200.9	2.3	ppb	2.0	20 ppb	07/27/16 17:05
6183006-45	Sample Name: Edwards #34 Sampled: 6/28/16 7:10		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-46	Sample Name: Edwards #30 Sampled: 6/28/16 7:13		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-47	Sample Name: Phy. Plant office sink Sampled: 6/28/16 6:00		Matrix: Water				
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-48	Sample Name: Phy. Plant shop break Room Sampled: 6/28/16 6:04		Matrix: Water				
+Lead	1030	EPA 200.9	9.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-49	Sample Name: Edwards Kit. Food Prep sink Sampled: 6/28/16 6:14		Matrix: Water				
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
6183006-50	Sample Name: Edwards Cafe fountain Sampled: 6/28/16 6:16		Matrix: Water				
+Lead	1030	EPA 200.9	5.1	ppb	2.0	20 ppb	07/27/16 17:05

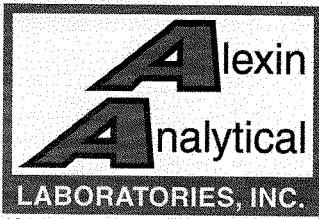

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-51	Sample Name: D.O. Basement breakroom Sampled: 6/28/16 6:20						Matrix: Water
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
6183006-52	Sample Name: D.O. 2nd fl Breakroom Sampled: 6/28/16 6:22						Matrix: Water
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
6183006-53	Sample Name: D.O. 2nd fl fountain Sampled: 6/28/16 6:24						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-54	Sample Name: Edwards #22 Sampled: 6/28/16 6:35						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-55	Sample Name: Edwards #21 Sampled: 6/28/16 6:39						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-56	Sample Name: Edwards fountain by Rm 20 Sampled: 6/28/16 6:43						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-57	Sample Name: Dundee #30 Sampled: 6/28/16 8:29						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-58	Sample Name: Dundee Gym Sampled: 6/28/16 8:32						Matrix: Water
+Lead	1030	EPA 200.9	7.8	ppb	2.0	20 ppb	07/27/16 17:05
6183006-59	Sample Name: Dundee Staff Kit Sampled: 6/28/16 8:37						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-60	Sample Name: Dundee fountain by office Sampled: 6/28/16 8:39						Matrix: Water
+Lead	1030	EPA 200.9	2.2	ppb	2.0	20 ppb	07/27/16 17:05

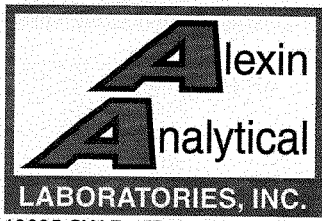

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-61	Sample Name: Dundee #20 Sampled: 6/28/16 8:42		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-62	Sample Name: Dundee #24 Sampled: 6/28/16 8:45		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-63	Sample Name: Dundee #10 Sampled: 6/28/16 8:48		Matrix: Water				
+Lead	1030	EPA 200.9	7.3	ppb	2.0	20 ppb	07/27/16 17:05
6183006-64	Sample Name: Dundee #14 Sampled: 6/28/16 8:50		Matrix: Water				
+Lead	1030	EPA 200.9	9.0	ppb	2.0	20 ppb	07/27/16 17:05
6183006-65	Sample Name: Dundee #18 Sampled: 6/28/16 8:53		Matrix: Water				
+Lead	1030	EPA 200.9	5.4	ppb	2.0	20 ppb	07/27/16 17:05
6183006-66	Sample Name: EY Gym Tall fountain Sampled: 6/28/16 9:14		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-67	Sample Name: EY Gym Short fountain Sampled: 6/28/16 9:18		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-68	Sample Name: EY Kit. Prep sink Sampled: 6/28/16 9:22		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
6183006-69	Sample Name: EY Cafe Fountain Sampled: 6/28/16 9:25		Matrix: Water				
+Lead	1030	EPA 200.9	3.8	ppb	2.0	20 ppb	07/27/16 17:05
6183006-70	Sample Name: EY Custodial Hall fountain Tall Sampled: 6/28/16 9:27		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

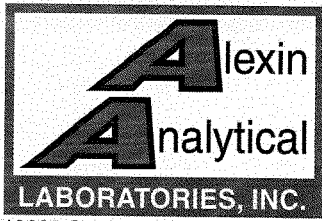

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-71	Sample Name: EY Custodial Hall fountain Short Sampled: 6/28/16 9:30						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-72	Sample Name: EY Hall fountain by staff Rm Tall Sampled: 6/28/16 9:34						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-73	Sample Name: EY Hall fountain by staff Rm Short Sampled: 6/28/16 9:38						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-74	Sample Name: EY #4 Sampled: 6/28/16 9:42						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-75	Sample Name: EY #5 Sampled: 6/28/16 9:44						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-76	Sample Name: EY Staff Rm Sampled: 6/28/16 9:50						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-77	Sample Name: CV fountain by 220 Tall Sampled: 6/28/16 10:44						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-78	Sample Name: CV fountain by 220 Short Sampled: 6/28/16 10:45						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-79	Sample Name: CV fountain by 100 Sampled: 6/28/16 10:53						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-80	Sample Name: AC Kit. Prep Sink Sampled: 6/28/16 11:01						Matrix: Water
+Lead	1030	EPA 200.9	6.5	ppb	2.0	20 ppb	07/29/16 15:17

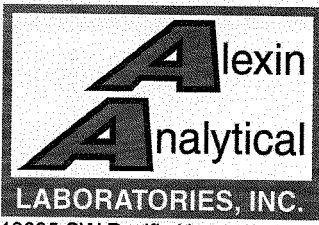

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006


C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-81	Sample Name: AC Cafe faucet fountain Sampled: 6/28/16 11:03		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-82	Sample Name: AC Gym fountain Sampled: 6/28/16 11:08		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-83	Sample Name: AC Fountain near Gym Tall Sampled: 6/28/16 11:13		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-84	Sample Name: AC Fountain near Gym Short Sampled: 6/28/16 11:14		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-85	Sample Name: AC Fountain by 1st fl boys short Sampled: 6/28/16 11:17		Matrix: Water				
†Lead	1030	EPA 200.9	2.5	ppb	2.0	20 ppb	07/29/16 15:17
6183006-86	Sample Name: AC Fountain by 1st fl boys tall Sampled: 6/28/16 11:20		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
6183006-87	Sample Name: J 108 N. Sink Sampled: 6/28/16 8:02		Matrix: Water				
†Lead	1030	EPA 200.9	2.9	ppb	2.0	20 ppb	07/29/16 15:17
6183006-88	Sample Name: J 108 S.E. Sink Sampled: 6/28/16 8:03		Matrix: Water				
†Lead	1030	EPA 200.9	48.6	ppb	4.0	20 ppb	07/29/16 15:17 MCLE
6183006-89	Sample Name: J 108 East Prep Sink Sampled: 6/28/16 8:05		Matrix: Water				
†Lead	1030	EPA 200.9	50.3	ppb	4.0	20 ppb	08/01/16 16:10 MCLE
6183006-90	Sample Name: J Hallway tall fountain Sampled: 6/28/16 8:10		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10

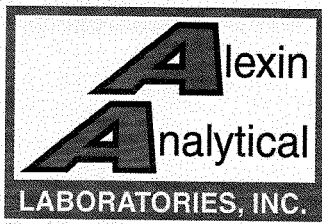

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016
Received: 06/29/2016
Sampled By: Ross McLeod
Work Order: 6183006

C **Newberg School District**
L Attn: Scott Woods
I 714 E 6th St.
E Newberg OR, 97132
N Phone: (503) 554-5024
T

Project: Lead Testing
Project # : Lead Testing
PWSID # :

Sampling Location: Newberg High School

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183006-91	Sample Name: J Hallway short fountain Sampled: 6/28/16 8:10		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
6183006-92	Sample Name: Section K tall fountain Sampled: 6/28/16 8:20		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
6183006-93	Sample Name: Section K small fountain Sampled: 6/28/16 8:20		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
6183006-94	Sample Name: Auditorium tall fountain Sampled: 6/28/16 8:30		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
6183006-95	Sample Name: Auditorium small fountain Sampled: 6/28/16 8:30		Matrix: Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.