

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-01</b>	<b>Sample Name:</b> North Cola Fountain <b>Sampled:</b> 6/29/16 6:43		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.3	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-02</b>	<b>Sample Name:</b> WESD Port Fountain <b>Sampled:</b> 6/29/16 6:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-03</b>	<b>Sample Name:</b> CV Boys LK <b>Sampled:</b> 6/29/16 7:35		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-04</b>	<b>Sample Name:</b> CV girls LK <b>Sampled:</b> 6/29/16 7:38		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-05</b>	<b>Sample Name:</b> CV Gym Tall <b>Sampled:</b> 6/29/16 7:31		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-06</b>	<b>Sample Name:</b> CV Gym Short <b>Sampled:</b> 6/29/16 7:33		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-07</b>	<b>Sample Name:</b> AC fountain 2nd fl. by boys Room Tall <b>Sampled:</b> 6/28/16 11:23		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-08</b>	<b>Sample Name:</b> AC fountain 2nd fl. by boys Room Short <b>Sampled:</b> 6/28/16 11:25		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-09</b>	<b>Sample Name:</b> AC - C202 <b>Sampled:</b> 6/28/16 11:28		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-10</b>	<b>Sample Name:</b> AC - Commons by A102 <b>Sampled:</b> 6/28/16 11:31		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	4.5	ppb	2.0	20 ppb	07/27/16 17:05

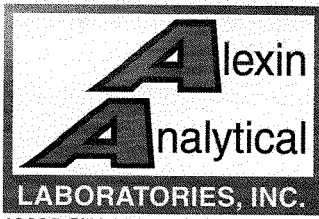

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

## Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-11</b>	<b>Sample Name:</b> AC - Staff Lunch Rm <b>Sampled:</b> 6/28/16 11:34		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-12</b>	<b>Sample Name:</b> Sitka main kit. sink <b>Sampled:</b> 6/28/16 12:51		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-13</b>	<b>Sample Name:</b> Sitka Game Rm <b>Sampled:</b> 6/28/16 12:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	<b>29.4</b>	ppb	2.0	20 ppb	07/27/16 17:05 <b>MCLE</b>
<b>6183006-14</b>	<b>Sample Name:</b> Sitka Back Port - fountain Right <b>Sampled:</b> 6/28/16 12:58		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	<b>67.1</b>	ppb	4.0	20 ppb	07/27/16 17:05 <b>MCLE</b>
<b>6183006-15</b>	<b>Sample Name:</b> Sitka Back Port - fountain Left <b>Sampled:</b> 6/28/16 13:03		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	2.4	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-16</b>	<b>Sample Name:</b> South Cola Port sink <b>Sampled:</b> 6/29/16 6:35		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	15.4	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-17</b>	<b>Sample Name:</b> CV kit. Prep sink <b>Sampled:</b> 6/28/16 10:12		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	9.7	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-18</b>	<b>Sample Name:</b> CV Fountains near Gym - Tall <b>Sampled:</b> 6/28/16 10:15		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-19</b>	<b>Sample Name:</b> CV Fountain near Gym - Short <b>Sampled:</b> 6/28/16 10:16		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-20</b>	<b>Sample Name:</b> CV Staff Rm <b>Sampled:</b> 6/28/16 10:20		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

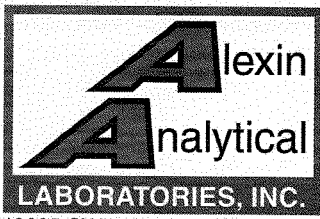

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-21</b>	<b>Sample Name:</b> Hall fountain by 117 Tall <b>Sampled:</b> 6/28/16 10:22						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-22</b>	<b>Sample Name:</b> Hall fountain by 117 Short <b>Sampled:</b> 6/28/16 10:24						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-23</b>	<b>Sample Name:</b> CV #112 <b>Sampled:</b> 6/28/16 10:28						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-24</b>	<b>Sample Name:</b> CV #113 <b>Sampled:</b> 6/28/16 10:31						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	4.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-25</b>	<b>Sample Name:</b> Hall fountain 211 - Tall <b>Sampled:</b> 6/28/16 10:36						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-26</b>	<b>Sample Name:</b> Hall fountain 211 Short <b>Sampled:</b> 6/28/16 10:39						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-27</b>	<b>Sample Name:</b> Edwards Fountain by #30 <b>Sampled:</b> 6/28/16 7:16						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-28</b>	<b>Sample Name:</b> Edwards #27 <b>Sampled:</b> 6/28/16 7:18						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-29</b>	<b>Sample Name:</b> Edwards #23 <b>Sampled:</b> 6/28/16 7:21						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	6.6	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-30</b>	<b>Sample Name:</b> Dundee Food Prep sink #1 Kit. <b>Sampled:</b> 6/28/16 8:03						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

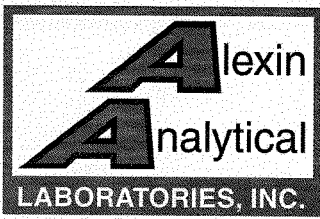

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

## Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-31</b>	<b>Sample Name:</b> Dundee Food Prep sink #2 Kit. <b>Sampled:</b> 6/28/16 8:04						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.7	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-32</b>	<b>Sample Name:</b> Dundee cafe fountain - Tall <b>Sampled:</b> 6/28/16 8:13						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-33</b>	<b>Sample Name:</b> Dundee cafe fountain - Short <b>Sampled:</b> 6/28/16 8:14						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-34</b>	<b>Sample Name:</b> Dundee #35 <b>Sampled:</b> 6/28/16 8:19						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	13.3	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-35</b>	<b>Sample Name:</b> Dundee #31 <b>Sampled:</b> 6/28/16 8:22						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-36</b>	<b>Sample Name:</b> Dundee #32 <b>Sampled:</b> 6/28/16 8:26						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-37</b>	<b>Sample Name:</b> Edwards Gym fountain <b>Sampled:</b> 6/28/16 6:48						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-38</b>	<b>Sample Name:</b> Edwards #15 <b>Sampled:</b> 6/28/16 6:51						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-39</b>	<b>Sample Name:</b> Edwards Hall fountain by #15 <b>Sampled:</b> 6/28/16 6:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-40</b>	<b>Sample Name:</b> Edwards #13 <b>Sampled:</b> 6/28/16 6:57						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

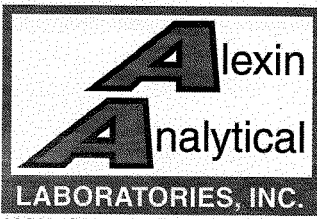

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-41</b>	<b>Sample Name:</b> Edwards Staff Lunch Rm <b>Sampled:</b> 6/28/16 7:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-42</b>	<b>Sample Name:</b> Edwards #39 <b>Sampled:</b> 6/28/16 7:02		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-43</b>	<b>Sample Name:</b> Edwards fountain by #39 <b>Sampled:</b> 6/28/16 7:05		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-44</b>	<b>Sample Name:</b> Edwards #38 <b>Sampled:</b> 6/28/16 7:08		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	2.3	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-45</b>	<b>Sample Name:</b> Edwards #34 <b>Sampled:</b> 6/28/16 7:10		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-46</b>	<b>Sample Name:</b> Edwards #30 <b>Sampled:</b> 6/28/16 7:13		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-47</b>	<b>Sample Name:</b> Phy. Plant office sink <b>Sampled:</b> 6/28/16 6:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-48</b>	<b>Sample Name:</b> Phy. Plant shop break Room <b>Sampled:</b> 6/28/16 6:04		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	9.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-49</b>	<b>Sample Name:</b> Edwards Kit. Food Prep sink <b>Sampled:</b> 6/28/16 6:14		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-50</b>	<b>Sample Name:</b> Edwards Cafe fountain <b>Sampled:</b> 6/28/16 6:16		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	5.1	ppb	2.0	20 ppb	07/27/16 17:05

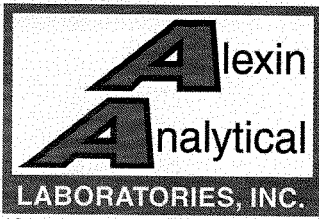

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-51</b>	<b>Sample Name:</b> D.O. Basement breakroom <b>Sampled:</b> 6/28/16 6:20						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.2	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-52</b>	<b>Sample Name:</b> D.O. 2nd fl Breakroom <b>Sampled:</b> 6/28/16 6:22						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-53</b>	<b>Sample Name:</b> D.O. 2nd fl fountain <b>Sampled:</b> 6/28/16 6:24						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-54</b>	<b>Sample Name:</b> Edwards #22 <b>Sampled:</b> 6/28/16 6:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-55</b>	<b>Sample Name:</b> Edwards #21 <b>Sampled:</b> 6/28/16 6:39						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-56</b>	<b>Sample Name:</b> Edwards fountain by Rm 20 <b>Sampled:</b> 6/28/16 6:43						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-57</b>	<b>Sample Name:</b> Dundee #30 <b>Sampled:</b> 6/28/16 8:29						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-58</b>	<b>Sample Name:</b> Dundee Gym <b>Sampled:</b> 6/28/16 8:32						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	7.8	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-59</b>	<b>Sample Name:</b> Dundee Staff Kit <b>Sampled:</b> 6/28/16 8:37						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-60</b>	<b>Sample Name:</b> Dundee fountain by office <b>Sampled:</b> 6/28/16 8:39						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.2	ppb	2.0	20 ppb	07/27/16 17:05

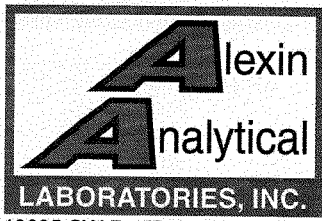

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-61</b>	<b>Sample Name:</b> Dundee #20 <b>Sampled:</b> 6/28/16 8:42		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-62</b>	<b>Sample Name:</b> Dundee #24 <b>Sampled:</b> 6/28/16 8:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-63</b>	<b>Sample Name:</b> Dundee #10 <b>Sampled:</b> 6/28/16 8:48		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	7.3	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-64</b>	<b>Sample Name:</b> Dundee #14 <b>Sampled:</b> 6/28/16 8:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	9.0	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-65</b>	<b>Sample Name:</b> Dundee #18 <b>Sampled:</b> 6/28/16 8:53		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	5.4	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-66</b>	<b>Sample Name:</b> EY Gym Tall fountain <b>Sampled:</b> 6/28/16 9:14		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-67</b>	<b>Sample Name:</b> EY Gym Short fountain <b>Sampled:</b> 6/28/16 9:18		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-68</b>	<b>Sample Name:</b> EY Kit. Prep sink <b>Sampled:</b> 6/28/16 9:22		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-69</b>	<b>Sample Name:</b> EY Cafe Fountain <b>Sampled:</b> 6/28/16 9:25		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.8	ppb	2.0	20 ppb	07/27/16 17:05
<b>6183006-70</b>	<b>Sample Name:</b> EY Custodial Hall fountain Tall <b>Sampled:</b> 6/28/16 9:27		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/27/16 17:05

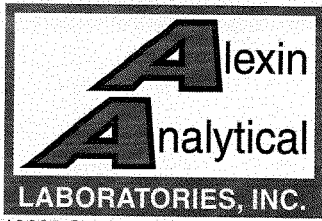

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**


**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-71</b>	<b>Sample Name:</b> EY Custodial Hall fountain Short <b>Sampled:</b> 6/28/16 9:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-72</b>	<b>Sample Name:</b> EY Hall fountain by staff Rm Tall <b>Sampled:</b> 6/28/16 9:34						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-73</b>	<b>Sample Name:</b> EY Hall fountain by staff Rm Short <b>Sampled:</b> 6/28/16 9:38						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-74</b>	<b>Sample Name:</b> EY #4 <b>Sampled:</b> 6/28/16 9:42						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-75</b>	<b>Sample Name:</b> EY #5 <b>Sampled:</b> 6/28/16 9:44						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-76</b>	<b>Sample Name:</b> EY Staff Rm <b>Sampled:</b> 6/28/16 9:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-77</b>	<b>Sample Name:</b> CV fountain by 220 Tall <b>Sampled:</b> 6/28/16 10:44						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-78</b>	<b>Sample Name:</b> CV fountain by 220 Short <b>Sampled:</b> 6/28/16 10:45						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-79</b>	<b>Sample Name:</b> CV fountain by 100 <b>Sampled:</b> 6/28/16 10:53						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-80</b>	<b>Sample Name:</b> AC Kit. Prep Sink <b>Sampled:</b> 6/28/16 11:01						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	6.5	ppb	2.0	20 ppb	07/29/16 15:17



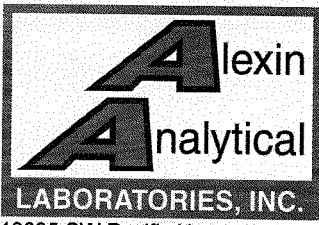

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006


**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

## Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-81</b>	<b>Sample Name:</b> AC Cafe faucet fountain <b>Sampled:</b> 6/28/16 11:03		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-82</b>	<b>Sample Name:</b> AC Gym fountain <b>Sampled:</b> 6/28/16 11:08		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-83</b>	<b>Sample Name:</b> AC Fountain near Gym Tall <b>Sampled:</b> 6/28/16 11:13		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-84</b>	<b>Sample Name:</b> AC Fountain near Gym Short <b>Sampled:</b> 6/28/16 11:14		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-85</b>	<b>Sample Name:</b> AC Fountain by 1st fl boys short <b>Sampled:</b> 6/28/16 11:17		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	2.5	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-86</b>	<b>Sample Name:</b> AC Fountain by 1st fl boys tall <b>Sampled:</b> 6/28/16 11:20		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-87</b>	<b>Sample Name:</b> J 108 N. Sink <b>Sampled:</b> 6/28/16 8:02		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	2.9	ppb	2.0	20 ppb	07/29/16 15:17
<b>6183006-88</b>	<b>Sample Name:</b> J 108 S.E. Sink <b>Sampled:</b> 6/28/16 8:03		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	48.6	ppb	4.0	20 ppb	07/29/16 15:17 <b>MCLE</b>
<b>6183006-89</b>	<b>Sample Name:</b> J 108 East Prep Sink <b>Sampled:</b> 6/28/16 8:05		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	50.3	ppb	4.0	20 ppb	08/01/16 16:10 <b>MCLE</b>
<b>6183006-90</b>	<b>Sample Name:</b> J Hallway tall fountain <b>Sampled:</b> 6/28/16 8:10		<b>Matrix:</b> Water				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10

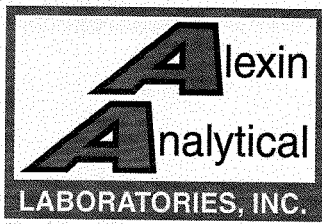

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/02/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183006

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Newberg High School

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183006-91</b>	<b>Sample Name:</b> J Hallway short fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/28/16 8:10						
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
<b>6183006-92</b>	<b>Sample Name:</b> Section K tall fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/28/16 8:20						
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
<b>6183006-93</b>	<b>Sample Name:</b> Section K small fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/28/16 8:20						
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
<b>6183006-94</b>	<b>Sample Name:</b> Auditorium tall fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/28/16 8:30						
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10
<b>6183006-95</b>	<b>Sample Name:</b> Auditorium small fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/28/16 8:30						
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/01/16 16:10

**MCL** This analyte exceeds the MCL limit.

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: \_\_\_\_\_

Adriana Gonzalez-Gray  
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-01</b>	<b>Sample Name:</b> B Hallway fountain - large <b>Sampled:</b> 6/28/16 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-02</b>	<b>Sample Name:</b> B Hallway fountain - small <b>Sampled:</b> 6/28/16 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-03</b>	<b>Sample Name:</b> A Hallway fountain - short <b>Sampled:</b> 6/28/16 5:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-04</b>	<b>Sample Name:</b> A Hallway fountain - tall <b>Sampled:</b> 6/28/16 5:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-05</b>	<b>Sample Name:</b> D Hallway fountain - short <b>Sampled:</b> 6/28/16 5:45						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-06</b>	<b>Sample Name:</b> D Hallway fountain - tall <b>Sampled:</b> 6/28/16 5:45						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-07</b>	<b>Sample Name:</b> Main Kitchen East Sink <b>Sampled:</b> 6/28/16 5:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-08</b>	<b>Sample Name:</b> Main Kitchen North Sink <b>Sampled:</b> 6/28/16 5:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-09</b>	<b>Sample Name:</b> Main Kitchen East Hand Sink <b>Sampled:</b> 6/28/16 5:55						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.8	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-10</b>	<b>Sample Name:</b> Middle Kitchen South Sink <b>Sampled:</b> 6/28/16 6:00						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	08/15/16 16:05



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-11</b>	<b>Sample Name:</b> West Commons South Sink <b>Sampled:</b> 6/28/16 6:15						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-12</b>	<b>Sample Name:</b> Healthroom Sink <b>Sampled:</b> 6/28/16 6:15						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-13</b>	<b>Sample Name:</b> Main office Workroom <b>Sampled:</b> 6/28/16 6:20						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	6.1	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-14</b>	<b>Sample Name:</b> Section B Clayroom west sink <b>Sampled:</b> 6/28/16 6:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-15</b>	<b>Sample Name:</b> E Hallway tall fountain <b>Sampled:</b> 6/28/16 6:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-16</b>	<b>Sample Name:</b> E Hallway short fountain <b>Sampled:</b> 6/28/16 6:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-17</b>	<b>Sample Name:</b> F Hallway short fountain <b>Sampled:</b> 6/28/16 6:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-18</b>	<b>Sample Name:</b> F 103 Front East Sink <b>Sampled:</b> 6/28/16 6:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>23.8</b>	ppb	2.0	20 ppb	08/15/16 16:05 <b>MCLE</b>
<b>6183007-19</b>	<b>Sample Name:</b> F 106 Front North East Sink <b>Sampled:</b> 6/28/16 6:55						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>80.2</b>	ppb	8.0	20 ppb	08/15/16 16:05 <b>MCLE</b>
<b>6183007-20</b>	<b>Sample Name:</b> F Hallway Tall fountain <b>Sampled:</b> 6/28/16 6:55						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C**  
**L**  
**I**  
**E**  
**N**  
**T**  
**Newberg School District**  
Attn: Scott Woods  
714 E 6th St.  
Newberg OR, 97132  
Phone: (503) 554-5024

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-21</b>	<b>Sample Name:</b> C 101 <b>Sampled:</b> 6/28/16 7:25		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	6.9	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-22</b>	<b>Sample Name:</b> Upstairs small fountain <b>Sampled:</b> 6/28/16 7:30		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-23</b>	<b>Sample Name:</b> Upstairs tall fountain <b>Sampled:</b> 6/28/16 7:35		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-24</b>	<b>Sample Name:</b> G 101B Sink <b>Sampled:</b> 6/28/16 7:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-25</b>	<b>Sample Name:</b> G Hallway Small fountain <b>Sampled:</b> 6/28/16 7:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-26</b>	<b>Sample Name:</b> G Hallway tall fountain <b>Sampled:</b> 6/28/16 7:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-27</b>	<b>Sample Name:</b> J 108 S.W. sink <b>Sampled:</b> 6/28/16 7:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	<b>40.9</b>	ppb	4.0	20 ppb	08/15/16 16:05 <b>MCLE</b>
<b>6183007-28</b>	<b>Sample Name:</b> J 108 S.E. Prep Sink <b>Sampled:</b> 6/28/16 8:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	15.3	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-29</b>	<b>Sample Name:</b> J 108 SW Prep Sink <b>Sampled:</b> 6/28/16 8:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	19.5	ppb	2.0	20 ppb	08/15/16 16:05
<b>6183007-30</b>	<b>Sample Name:</b> J 108 NW Sink <b>Sampled:</b> 6/28/16 8:01		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	11.4	ppb	2.0	20 ppb	08/15/16 16:05



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-31</b>	<b>Sample Name:</b> NE Tall fountain <b>Sampled:</b> 6/28/16 10:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-32</b>	<b>Sample Name:</b> NE Short fountain <b>Sampled:</b> 6/28/16 10:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-33</b>	<b>Sample Name:</b> East Cafeteria sink <b>Sampled:</b> 6/28/16 10:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-34</b>	<b>Sample Name:</b> West Cafeteria sink <b>Sampled:</b> 6/28/16 10:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-35</b>	<b>Sample Name:</b> fountain between Red/Blue hall <b>Sampled:</b> 6/28/16 11:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-36</b>	<b>Sample Name:</b> Blue hall fountain - short <b>Sampled:</b> 6/28/16 11:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-37</b>	<b>Sample Name:</b> Blue hall fountain tall <b>Sampled:</b> 6/28/16 11:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-38</b>	<b>Sample Name:</b> fountain N.W. Corner <b>Sampled:</b> 6/28/16 11:10		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-39</b>	<b>Sample Name:</b> fountain SE Corner <b>Sampled:</b> 6/28/16 11:15		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-41</b>	<b>Sample Name:</b> N.E. Kitchen Sink <b>Sampled:</b> 6/28/16 11:30		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	<b>20.6</b>	ppb	2.0	20 ppb	08/16/16 17:21 <b>MCLE</b>



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C**  
**L**  
**I**  
**E**  
**N**  
**T**  
**Newberg School District**  
Attn: Scott Woods  
714 E 6th St.  
Newberg OR, 97132  
Phone: (503) 554-5024

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-42</b>	<b>Sample Name:</b> Middle Kitchen hand sink <b>Sampled:</b> 6/28/16 11:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.6	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-43</b>	<b>Sample Name:</b> South Kitchen Prep Sink <b>Sampled:</b> 6/28/16 11:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	16.0	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-44</b>	<b>Sample Name:</b> West Kitchen Prep sink <b>Sampled:</b> 6/28/16 11:35						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>32.0</b>	ppb	2.0	20 ppb	08/16/16 17:21 <b>MCL E</b>
<b>6183007-45</b>	<b>Sample Name:</b> Office Conference room <b>Sampled:</b> 6/28/16 11:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.9	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-46</b>	<b>Sample Name:</b> Tall drinking fountain - SEC <b>Sampled:</b> 6/28/16 12:10						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-47</b>	<b>Sample Name:</b> Short drinking fountain - SEC <b>Sampled:</b> 6/28/16 12:15						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-48</b>	<b>Sample Name:</b> Commons sink - SEC <b>Sampled:</b> 6/28/16 12:20						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-49</b>	<b>Sample Name:</b> Breakroom - SEC <b>Sampled:</b> 6/28/16 12:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-50</b>	<b>Sample Name:</b> Healthroom - SEC <b>Sampled:</b> 6/28/16 12:55						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-51</b>	<b>Sample Name:</b> Cafeteria West sink <b>Sampled:</b> 6/28/16 13:45						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.5	ppb	2.0	20 ppb	08/16/16 17:21



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-52</b>	<b>Sample Name:</b> Cafeteria East sink <b>Sampled:</b> 6/28/16 13:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	4.7	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-53</b>	<b>Sample Name:</b> Health room <b>Sampled:</b> 6/28/16 13:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.5	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-54</b>	<b>Sample Name:</b> Gym fountain <b>Sampled:</b> 6/28/16 14:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-55</b>	<b>Sample Name:</b> Small fountain across gym <b>Sampled:</b> 6/28/16 14:05		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-56</b>	<b>Sample Name:</b> Tall fountain across gym <b>Sampled:</b> 6/28/16 14:05		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-57</b>	<b>Sample Name:</b> Tall commons fountain <b>Sampled:</b> 6/29/16 5:30		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-58</b>	<b>Sample Name:</b> Short commons fountain <b>Sampled:</b> 6/29/16 5:30		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-59</b>	<b>Sample Name:</b> Short upstairs fountain <b>Sampled:</b> 6/29/16 5:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-60</b>	<b>Sample Name:</b> Tall upstairs fountain <b>Sampled:</b> 6/29/16 5:45		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-61</b>	<b>Sample Name:</b> Staff room <b>Sampled:</b> 6/29/16 6:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.8	ppb	2.0	20 ppb	08/16/16 17:21





**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-62</b>	<b>Sample Name:</b> Kitchen N.E. Sink - MV <b>Sampled:</b> 6/28/16 9:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	21.8	ppb	2.0	20 ppb	08/16/16 17:21 <b>MCLE</b>
<b>6183007-63</b>	<b>Sample Name:</b> Kitchen N.W. Sink - MV <b>Sampled:</b> 6/28/16 9:50		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	8.9	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-64</b>	<b>Sample Name:</b> Kitchen South Sink MV <b>Sampled:</b> 6/28/16 9:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	7.2	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-65</b>	<b>Sample Name:</b> Kitchen Middle Prep sink <b>Sampled:</b> 6/28/16 9:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	16.8	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-66</b>	<b>Sample Name:</b> Short fountain near 153 MV <b>Sampled:</b> 6/29/16 6:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-67</b>	<b>Sample Name:</b> Tall fountain near 153 MV <b>Sampled:</b> 6/29/16 6:55		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-68</b>	<b>Sample Name:</b> Gym fountain MV <b>Sampled:</b> 6/29/16 7:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	3.0	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-69</b>	<b>Sample Name:</b> Health room MV <b>Sampled:</b> 6/29/16 7:05		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	7.9	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-70</b>	<b>Sample Name:</b> Sink near 105 MV <b>Sampled:</b> 6/29/16 7:10		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	2.2	ppb	2.0	20 ppb	08/16/16 17:21
<b>6183007-71</b>	<b>Sample Name:</b> fountain near 211 MV <b>Sampled:</b> 6/29/16 7:30		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	6.8	ppb	2.0	20 ppb	08/16/16 17:21



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 08/18/2016  
Received: 06/29/2016  
Sampled By: Ross McLeod  
Work Order: 6183007

**C** **Newberg School District**  
**L** Attn: Scott Woods  
**I** 714 E 6th St.  
**E** Newberg OR, 97132  
**N** Phone: (503) 554-5024  
**T**

**Project:** Lead Testing  
**Project # :** Lead Testing  
**PWSID # :**

Sampling Location: Mountain View

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6183007-72</b>	<b>Sample Name:</b> Fountain by room 111 <b>Sampled:</b> 6/29/16 7:50						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	6.6	ppb	2.0	20 ppb	08/17/16 15:50
<b>6183007-73</b>	<b>Sample Name:</b> Sink near 205 <b>Sampled:</b> 6/29/16 7:35						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	10.8	ppb	2.0	20 ppb	08/17/16 15:50
<b>6183007-74</b>	<b>Sample Name:</b> Staff room <b>Sampled:</b> 6/29/16 7:40						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	2.8	ppb	2.0	20 ppb	08/17/16 15:50

**MCLE** This analyte exceeds the MCL limit.

**ND** = None detected at the MRL      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by:   
Adriana Gonzalez-Gray  
Laboratory Director



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 08/24/2016  
Received: 08/22/2016  
Sampled By: Scott Woods  
Work Order: 6235003

**C**  
**L**  
**I**  
**E**  
**N**  
**T**  
**Newberg School District**  
Attn: -  
714 E 6th St.  
Newberg OR, 97132  
Phone: (503) 554-5024

**Project:** Lead Testing  
Project # : N/A  
PWSID # :

Sampling Location: Various - Re-test

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6235003-01</b>	<b>Sample Name:</b> NHS J108 SW Sink - First Draw <b>Sampled:</b> 8/22/16 7:00						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	18.8	ppb	2.0	20 ppb	08/22/16 16:38
<b>6235003-02</b>	<b>Sample Name:</b> South Cola Port Sink - First Draw <b>Sampled:</b> 8/22/16 6:45						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	12.3	ppb	2.0	20 ppb	08/23/16 15:46

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit  
†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by:   
Adriana Gonzalez-Gray  
Laboratory Director